



## STRUCTURAL ENGINEERING CASE STUDY REPORT: *PT Wafflemat™ Slab with Basement Foundation System*

[ Denver Metro Area ]

*Aurora Charlton* | E.I.  
Engineering Manager  
**Front Range Engineering, LLC**

### OVERVIEW

The current trend for the Residential (single and multi-family) housing market in Colorado: foundations once constructed on Post Tensioned-Slabs (ribbed and California-Type slabs) with the new requirements for specifying design values are becoming so cost prohibitive that builders in the Denver market are looking at going back to conventional foundation types (grade beams supported on piers or footings) with wood floors at the main level.

With the acceptance of the Third Edition of the PTI's Design and Construction of Post Tensioned Slabs and the 2006IRC/IBC manuals looming in the near future, the race for affordable and high performance slab-on-grade designs is becoming heated. It appears that the terms "affordable" and "high performance" seem to cancel each other out. Usually higher performance slabs tend to be thicker and stiffer, which (most builders know) doesn't make them affordable.

In addition, with most of the Denver Metro extending out from its current borders, the only available lands lie currently North, South and East of the present Denver Metropolitan Area. [This usually means more expansive soils, with higher clay content.] With worsening soil conditions, this can only mean that slab-on-grade systems need to get thicker, with more reinforcing (tendons and bar placements closer together) to handle the larger cantilevered sections caused by higher swelling and consolidating soils.

Pacific Housing Systems had asked Front Range Engineering, LLC to conduct an analysis of the current Wafflemat Slab with Basement foundation system and determine what extent of swelling and compressible soils it could withstand. Design constants were held similar to those original models conducted by John Cook of MKM & Associates. Our models were generated similar to those of MKM & Associates, and are noted below.

#### MATERIAL PROPERTIES

Concrete Compressive Strength = 4500 psi (similar to MKM Model)  
Concrete Unit Weight = 145 pcf  
Tendon Diameter = 1/2 inch  
Tendon Strength = 270 ksi tensile strength  
Minimum Prestress on slab (with all losses) = 50 psi  
Slab thickness = 7"  
Slab Geometry Analyzed = 38' x 58'

#### LOAD, DEFLECTION + PRESTRESS


Uniform Superimposed Load = 50 plf  
Perimeter Total Load = 1600 plf  
Edge Lift Load Min. = 1600 plf  
Center Lift Deflection = L/480  
Edge Lift Deflection = L/480 (for sided exteriors)  
Prestress Losses = 15 ksi  
Minimum Prestress on slab (with all losses) = 50 psi  
Line Load (short dir) = 800 plf

#### PTI METHOD

A design summary of the reported values above was used as a supplemental evaluation of the Adapt concrete model specified below. The original statements in the John Cook/MKM & Associates, LLC report still hold true and act as reference to this report.

#### ADAPT FINITE ELEMENT MODEL

The Adapt concrete slab model is slightly different from the PTI Method since the loadings used are those calculated for that structure. With the PTI method, a maximum loading is applied to the entire slab perimeter, with the option of supplying a line load in either direction located at the middle of the slab. This is usually not the way most residential homes are constructed. The advantages of the Adapt model are those just opposite the PTI Method. Each and every load applied to the Adapt model is the loading that the slab is most likely to experience during the serviceability/life of the structure. In addition, structural detailing can be added to the slab for those areas not within design parameters (higher in actual stresses and shear) to achieve the most economical design for the materials used.

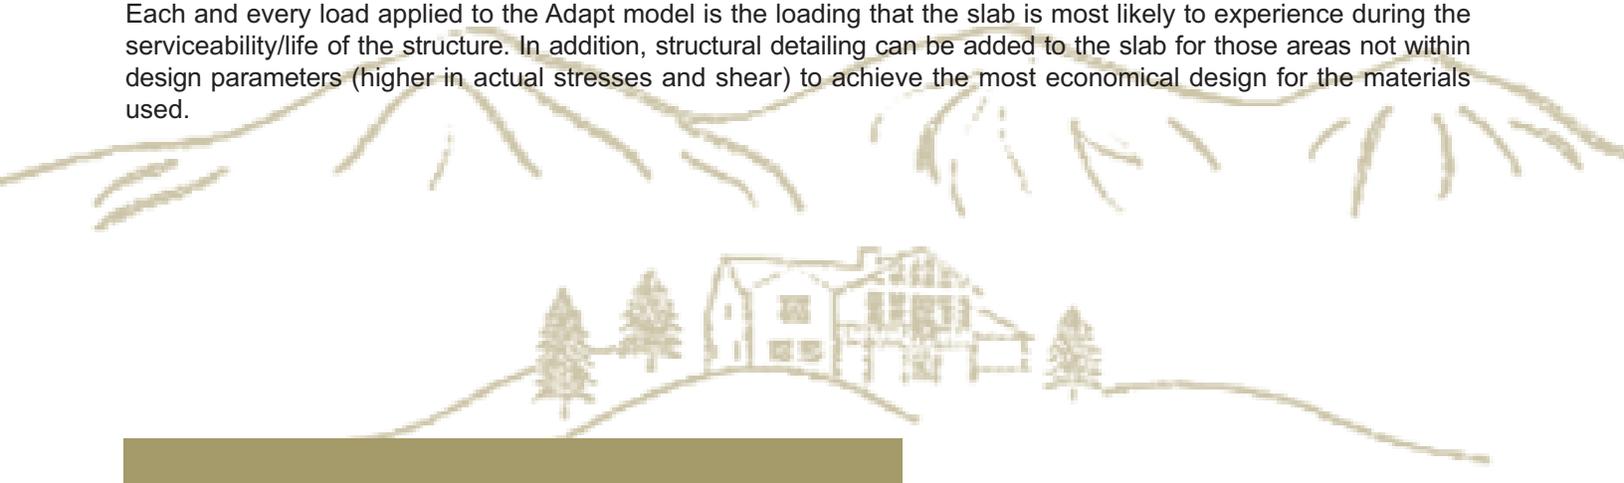

## RESULTS + ADVANTAGES

The Adapt model was analyzed for the continual worsening soil design data. The Wafflemat™ system, was able to withstand the following soil parameters. Values higher than those stated below failed in shear and bending.

Bearing Capacity = 2000 - 3000 psf  
Center Lift  $e_m = 5.5$  feet,  $y_m = 4.0$  inches  
Edge Lift  $e_m = 2.5$  feet,  $y_m = 3.0$  inches


The results seem reasonable since the added stiffness from the numerous ribs adds to the overall system. Additional reinforcing was added as a precaution against shrinkage and temperature cracking at all re-entrant corners as typically specified by most post tensioned slab designers in the Denver Metro Area.

The Adapt model showed that the values for Center Lift deflection ( $d$ ) are based on  $d \leq y_m / (3) = 1.3$  inches (or less) for the model to be valid. Similarly, the Edge Lift deflection ( $d$ ) is based on  $d \leq e_m \times (3) = 9.0$  inches (or less). This is standard practice for models created using the Adapt Method for expansive soil conditions. The PTI method is limited in its analysis with  $y_m$  less than 4.0 inches, and recommends the use of finite element analysis to be performed for  $y_m$  greater than 4.0 inches, which is done by Adapt. A PTI method was also generated for this analysis as a comparison.

It is our opinion that the use of PT cables in this design is part of the integral performance to combat the potential for slab movement in swelling soil conditions; therefore, a normally reinforced slab was not analyzed here (although this may prove to be a valid design option on predominantly sandy soils with no expansive properties and relatively low differential settlement).

It appears that the Wafflemat System has an advantage over the increasing demands for the affordable, higher performance Post Tensioned Slab on Grade. Those advantages appear to be as follows:

- The slab's ability to withstand larger cantilevers created by soil design parameters are much larger than those specified by the PTI method (3'-8" on center rather than 6'-0" on center). Similar to wood construction, the closer the ribs, the larger the cantilever and the amount of load it can withstand.
- Reduced Labor costs for hand excavation. Minor backfilling will be required, but should be minimal compared to the labor for trench cleanout.
- Concrete contractors have a more definite value for concrete costs; since the earth formed trenches induce more concrete volume from trench to slab transitions, this would be greatly reduced with a Wafflemat system.

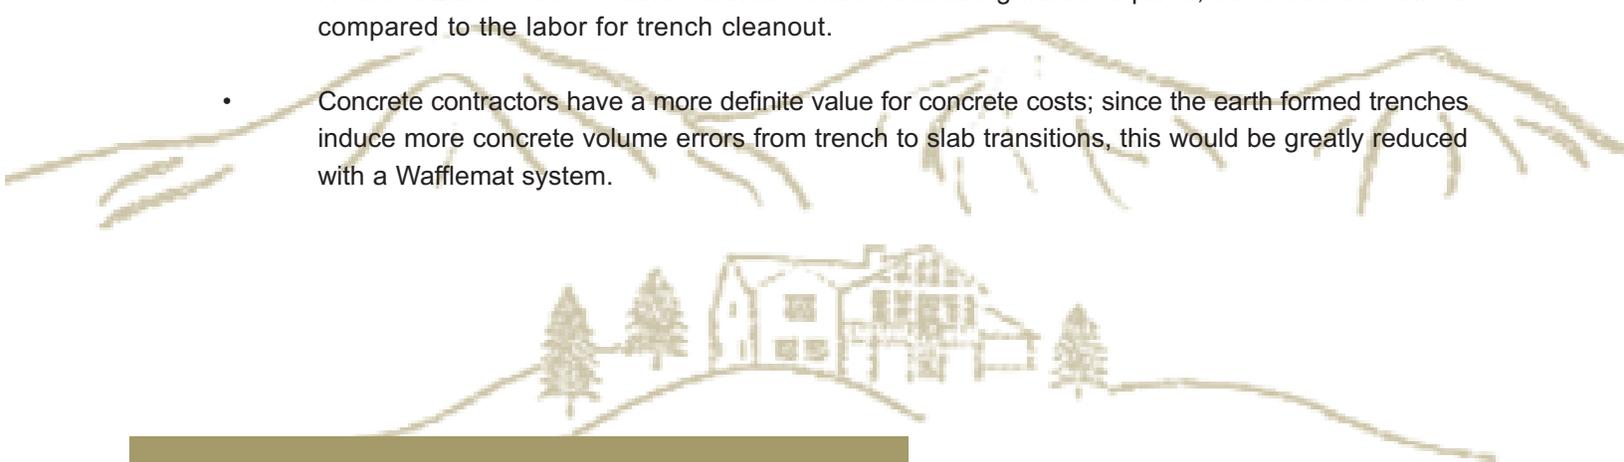


- Will replace labor and materials needed for structural wood and concrete basement floors.
- The use of form-a-drain as perimeter form section will reduce additional steps needed to install the system since it is already in place. In fact, rock may be added at the time of the basement slab pour since there are no walls to maneuver around; installation of the rock required should be reduced significantly.
- Additional form-a-drain product may also be installed to combat radon emissions under the slab (before pouring). A sealed sump pit with piping can be directly vented to the outside of the home.
- Reduced overall installation time for the builder/developer and foundation contractor.
- The ability, through additional reinforcing (either by tendons or conventional reinforcing), to handle higher swelling soil conditions with less deformation and thinner slab sections than earth formed ribs.
- Provides a built-in structural basement floor capable of withstanding higher values of stress and movement as compared with non-structural slabs on grade.

Since every foundation system is unique in its loading characteristics, each PT Wafflemat slab situation should be analyzed on a case-by-case basis and is in no way transferable between residential construction plans or job sites.

It is still the responsibility of a qualified geotechnical engineer to verify the validity of this type of foundation system on the higher moderate to highly expansive soils and/or in the 'Dipping Bedrock Overlay District' located along the Front Range of Colorado. The extent of over/sub-excavation will still be required to be determined and reviewed by the geotechnical engineer of record, but the analysis done by this office and others is here to present the validity and use of this system for edge and center differential movements reportedly larger than 4 inches maximum (PTI's section 4.2.B.3), and can be analyzed by using finite element methods (Adapt Model Method used in conjunction with PTI method). Fortunately, this system may provide a viable alternate to pier/grade beams with structural wood/concrete floors designed on lower to moderately expansive soils in the Denver Area.

This concludes our analysis of the **PT Wafflemat™ Slab with Basement Foundation** system.

The End.

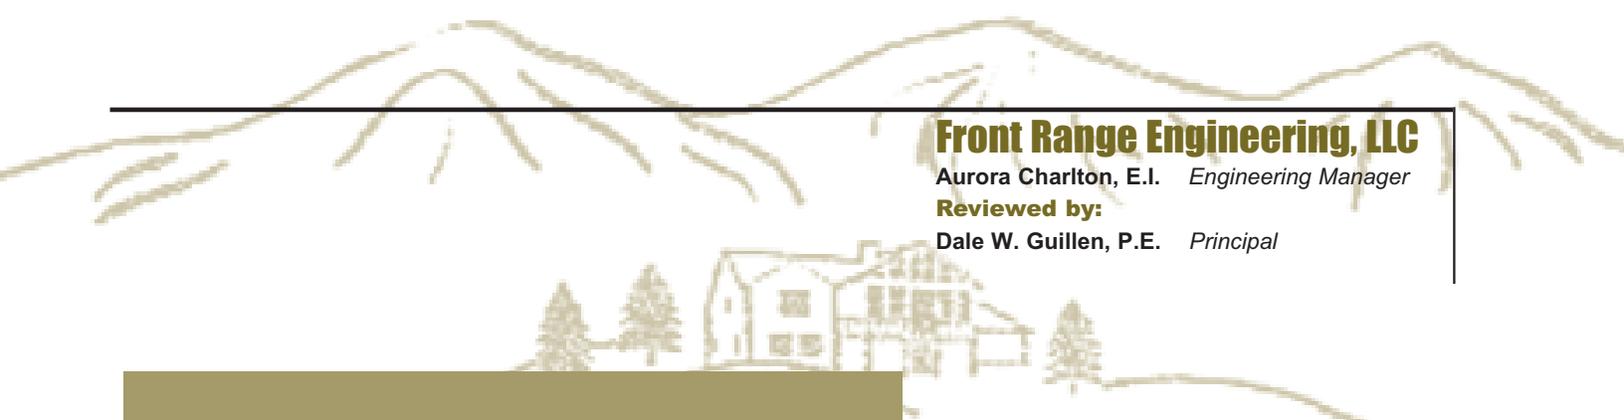

---

**Front Range Engineering, LLC**

Aurora Charlton, E.I. *Engineering Manager*

**Reviewed by:**

Dale W. Guillen, P.E. *Principal*